

# Power Factor Improvement of DC/DC Converters for Micro-turbines

H.R. Baghaee<sup>1</sup>, M. Mirsalim<sup>2</sup>, M. Ale-Emran<sup>1</sup>, M. Abedi<sup>1</sup>, and G.B. Gharehpetian<sup>1</sup>

<sup>1</sup> Department of Electrical Engineering  
Amirkabir University of Technology  
Hafez Ave, Tehran, (Iran)

Phone/Fax number: 0098-21-66466009; 0098-21-66406469,

<sup>2</sup> Also, with the Electrical Engineering Dept. at St. Mary's University, San Antonio, TX, US

e-mails: [hbaghaee@aut.ac.ir](mailto:hbaghaee@aut.ac.ir), [mirsalim@aut.ac.ir](mailto:mirsalim@aut.ac.ir), [aleemran2000@gmail.com](mailto:aleemran2000@gmail.com), [abedi@aut.ac.ir](mailto:abedi@aut.ac.ir), [grptian@aut.ac.ir](mailto:grptian@aut.ac.ir)

**Abstract.** The distributed generation interconnection to the power system can have impact not only on the power flow, but also on power quality of customers, and utilities. This paper proposes a multi-function nonlinear link for distribution generation systems. The main function of this link is to regulate the active power supplied from distribution generation to the utility. The link can also supply reactive power to the utility to enable unity power factor operation or to regulate the voltage at the point of common coupling. This link can also be controlled to mitigate power quality problems. Genetic algorithm is also used for the optimization of parameters of the power factor correction controller. The simulation performed in MATLAB/Simulink validates the effectiveness of the proposed power factor scheme.

## Key words

Micro-Turbine, DC/DC Converter, Power Quality, Genetic Algorithm, Distribution Generation

## 1. Nomenclature

$L_d, L_q$	d and q axes inductances
$R$	Resistance of the stator windings
$i_d, i_q$	d and q axes currents
$v_d, v_q$	d and q axes voltages
$\omega_r$	Angular velocity of the PMSM rotor
$\lambda$	Flux-linkages induced by the permanent magnets in the stator windings.
$P$	Number of pole-pairs
$T_e$	Electromagnetic torque
$J$	Combined inertia of rotor and load
$F$	Combined viscous friction of rotor and load
$\theta$	Rotor angular position
$T_m$	Shaft mechanical torque
$V_{in}$	input voltage of DC/DC converter
$T_s$	switching cycle
$i_L$	inductor current in the DC/DC converter

$V_o$	output voltage of DC/DC converter
$d$	duty cycle in each switching cycle
$i_{ref}$	reference value of $i_L$
$V_{ref}$	reference value of $V_o$
$k_{PID}$	is the peak value of the reference current
$K_p$	proportional gain of PI controller
$K_i$	integral gain of PI controller

## 2. Introduction

The fundamental concepts for the penetration of Distribution Generation (DG) technologies are the high efficiency, flexibility and reliability of the energy conversion process and the limited emission of pollutants as compared to conventional power plants. Moreover, they provide load management and a number of significant local benefits. The integration of the increasing part of DG within the existing infrastructure requires a full understanding of its impact on the distribution feeders and its interaction with the loads. DG sources could have positive impact on the operation of power systems to which they are connected. Voltage control, stability, and system protection have been studied in the literature as the operational aspects which require full understanding [1-4].

In recent years, power quality has become a significant issue for both power suppliers and customers [5-6]. The DG interconnection to the power system can have impact not only on the power flow and power quality, but also on customers, and utilities. The impacts may be considerable depending on the distribution system and DG characteristics. The DG can improve the power quality, the system reliability and reduce the losses. Their connection to the distribution system can also result in operational difficulties. Thus, DGs should meet various operating requirements of utilities or power system operators. However, the well-designed and well-controlled DGs can improve power quality. A new control system for independent operation of parallel connected DG Units in distribution DC Systems has been proposed in [6]. Many aspects of interconnection of DG

units to the grid have been presented in [7-9]. Also, neural implementation of micro-grid central controllers has been discussed in [10]. These DGs can protect the local loads against the voltage sag and swell, and also compensate harmonics. The power quality aspects of interconnection of DG to the grid have been considered in [11-13]. In [11], a control scheme for the DG interface to mitigate power quality problems has been presented. Besides, an inverter based flexible DG (FDG) with its control scheme has been introduced in [12] to improve power quality in a weak power system. Also, current harmonics analysis of the DG interconnection to the grid is discussed in [13].

The micro-turbine generator (MTG) has emerged as a viable source of electric energy in DG systems. It can also provide power demand for remote military/commercial applications, and as a stand-alone generator unit. An MTG unit is usually a high-speed (up to 120,000 rpm) machine with an output power of a few hundred kilowatts, and output frequency of 400 Hz (400 Hz to several kHz). Thus, it should be interfaced through a power electronic converter to a load/utility system. The converter provides conversion control of frequency as well as control of the output voltage and power flow of the MTG-converter module [14-15]. Two methods have been presented to convert the high frequency voltage of MTG to the desired 50 or 60 Hz voltage; one, using the rectifier-inverter pair [15-17], and two, using matrix converter [18].

This paper proposes a multi-function nonlinear link for DG systems. The main function of this link is to regulate the active power supplied from a DG to the utility. It should be noted that the link can also supply reactive power to the utility to enable unity power factor operation or to regulate the voltage at the point of common coupling (PCC). This link can also be controlled to compensate the harmonics generated from nonlinear loads to mitigate power quality problems. A DC/DC converter is implemented to eliminate harmonics on the AC side and correct the power factor. A distribution generation with this multi-function interface is known as flexible distribution generation (FDG). It alleviates most of the distribution system problems without using any custom power devices. The simulation performed in MATLAB/Simulink validates the effectiveness of the proposed power factor scheme in harmonic elimination and power factor improvement.

### 3. System Under Study

Figure 1 demonstrates the configuration of the system under study. Here, the DC input voltage to the shunt converter comes from a rectified DG through a smoothing capacitor  $C$ , the transformer ( $T$ ), and the current smoothing filter. The converter manages the amount of current  $I_c$  injected to the utility. The main goal of this paper is to eliminate the harmonic contents of the input current of diode rectifier and to improve the power factor from the standpoint of the output current of MTG. In the next section, power factor correction scheme is introduced to eliminate the harmonics and improve the power factor.

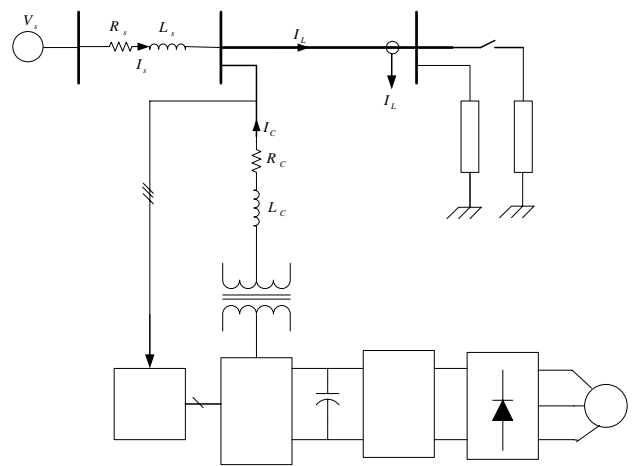


Fig. 1 Configuration of the system under study

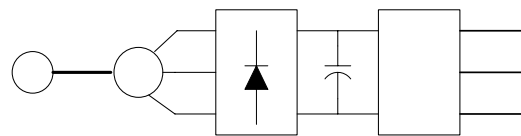


Fig. 2 The configuration of a MTG system

## 4. Proposed Power Factor Correction Scheme for Micro Turbine Generator

### A. MTG System

Fig. 2 depicts the basic components of a micro-turbine generation system. A simplified single-shaft gas turbine with control systems which is implemented in MATLAB/Simulink environment is shown in Fig. 3. The model consists of temperature control, fuel control, turbine dynamics, speed governor and acceleration control blocks which has previously been developed in MATLAB/Simulink environment [19-20]. In this paper, a lead-lag transfer function is used to represent the speed controller. The governor controls with parameters gain, X, Y and Z can be adjusted so that to act with a droop or as an isochronous governor. During turbine startup, acceleration control is used primarily to limit the rate of the rotor acceleration prior to reaching the operating speed. At rated speed, the acceleration control can be eliminated in the modeling. The output of the governor goes to a low value select to produce a value for the fuel demand signal ( $V_{ce}$ ). The other signal into the low-value select is from the temperature controller. The per-unit value of mechanical power on the basis of turbine power at steady state, corresponds directly to the per-unit value for  $V_{ce}$ . The fuel-flow controls as a function of  $V_{ce}$ , are shown in a series of blocks including the valve position and flow dynamics. The value of  $V_{ce}$ , is scaled by the gain value of 0.77 and offset by the value of fuel-flow at no load with rated speed condition [19-20]. The time delay preceding the fuel-flow controls represents the delays in the governor control. The fuel flow, burned in the combustor produces the turbine torque and the exhaust gas temperature measured by a thermocouple. Normally the reference temperature value is higher than



The duty cycle calculated by (9) can achieve unity power factor in a boost converter. Equation (9) can be rearranged as follows:

$$d(n) = d_1(n) + d_2(n) \quad (10)$$

where:

$$d_1(n) = \frac{(i_{ref}(n+1) - i_L(n)) \cdot \frac{L}{T_s}}{V_{ref}} \quad (11)$$

$$d_2(n) = 1 - \frac{V_{in}(n)}{V_{ref}} \quad (12)$$

$d_1(n)$  is the current forcing component (CFC). In steady state, the inductor current,  $i_L(n+1)$ , follows the reference current,  $i_{ref}(n+1)$ , at the end of the switching cycle. Therefore, the numerator of (11) is the inductance times the derivative of inductor current in one switching cycle as:  $V_L = L \frac{di_L(t)}{dt} = \frac{L}{T_s} [i_L(n+1) - i(n)]$ . In

transient state,  $d_1(n)$  forces the inductor current to follow the reference current which is determined by the power balance between the input and output of the converter.  $d_1(n)$  ensures the output voltage  $V_o$ , to be regulated to follow the reference voltage for transient state. In (7), the reference current is calculated by the following:

$$i_{ref}(n+1) = k_{PID} \cdot |\sin(\omega_{line} \cdot t(n+1))| \quad (13)$$

$k_{PID}$  is the peak value of the reference current, which is the output of the voltage loop controller.  $|\sin(\omega_{line} \cdot t(n+1))|$  is the rectified line frequency sinusoidal waveform, which is stored as a look-up table. In the implementation, the input voltage could be sensed and processed to produce the unity rectified line frequency sinusoidal waveform. The advantage of using the look-up table to generate  $|\sin(\omega_{line} \cdot t(n+1))|$  is that the sinusoidal input current waveform can be achieved under non-sinusoidal input voltage conditions. The second component,  $d_2(n)$ , in (11) is determined by the input and output voltage equilibrium of the boost topology. Therefore,  $d_2$  is defined as the Voltage

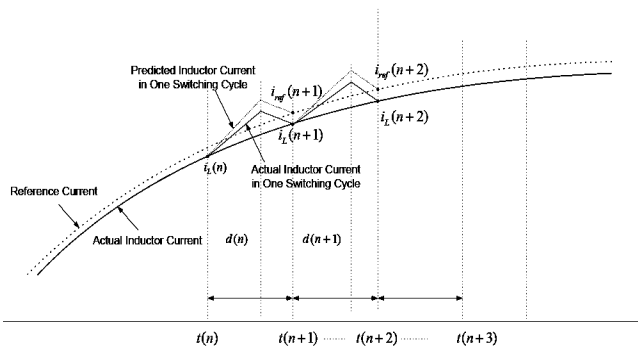


Fig. 5 Inductor current controlled by directly calculated duty cycles

Equilibrium Component (VEC). In (13),  $V_{in}(n)$  is the instantaneous input voltage value sensed by the input voltage fed-forward channel, as shown in Fig. 4.  $d_2(n)$  can guarantee stability of  $V_o$  for input voltage variations. Now, by substituting (13) into (9), the proposed PFC control algorithm can be expressed by the following equation:

$$d(n) = \frac{k_{PID} \cdot |\sin(\omega_{line} \cdot t(n+1))| - i_L(n)}{K_C} + \frac{V_{ref} - V_{in}(n)}{V_{ref}} \quad (14)$$

where,  $K_C = \frac{T_s V_{ref}}{L}$ , is a constant which characterizes

the inductor current fluctuation in one switching cycle when only the reference voltage is applied on the inductor. This constant is defined as intrinsic current slope constant in this paper. The duty cycle  $d(n)$ , in (9) is generated based on two principals: the actual inductor current,  $i_L(n)$ , which is sensed at the beginning of the present switching cycle  $t(n)$ , and the desired inductor current,  $i_{ref}(n+1)$ , which is the reference current value at the beginning of the next switching cycle,  $t(n+1)$ , as shown in Fig. 5. The inductor current is controlled by  $d(n)$  to follow the reference current. At  $t(n+1)$ , the inductor current  $i_L(n)$  may not be exactly the same as, but very close to the reference current  $i_{ref}(n+1)$ . Because the reference current is sinusoidal, the actual inductor current will also be sinusoidal to achieve unity power factor.

#### D. Simplification of the Proposed PFC Control Algorithm

In the digital implementation of the proposed duty cycle calculation algorithm, (10), (12) and (13) can be simplified by multiplying all the parameters with the constant  $K_C$ , as follows:

$$D(n) = D_1(n) + D_2(n) \quad (15)$$

$$D_1(n) = k_{PID} \cdot |\sin(\omega_{line} \cdot t(n+1))| - i_L(n) \quad (16)$$

$$D_2(n) = K_C - V'_{in}(n) \quad (17)$$

where,  $D_1(n) = d_1(n) \cdot K_C$ ,  $D_2(n) = d_2(n) \cdot K_C$ ,

$$\text{and } V'_{in}(n) = \frac{V_{in}(n)}{V_{ref}} \cdot K_C = \frac{T_s}{L} V_{in}(n)$$

It is observed from (15), (16) and (17) that, only one multiplication and three additions (subtractions) are required to implement the proposed duty cycle control algorithm. Now, the proposed PFC control algorithm is very simple, and a low cost digital signal processor, microprocessor or field programmable gate array (FPGA) can be used to implement the PFC, operating at a high switching frequency.

## 5. Proposed Genetic Algorithm

In order to optimize the PFC, genetic algorithm (GA) which is based on natural evolution and population is implemented. This algorithm is usually used to reach a near global optimum solution. In each iteration of GA (referred as generation), a new set of string (i.e. chromosomes) with improved fitness is produced using genetic operators (i.e. selection, crossover and mutation).

### Chromosome's structure

Chromosome structure of a GA is shown in Fig. 6. This involves the  $K_p$ , and  $K_i$  as parameters of the controller.

### B. Selection

The method of tournament selection is used for selections in a GA [24-25]. This method chooses each parent by choosing  $n_t$  (tournament size) players randomly, and choosing the best individual out of that set to be a parent. In this paper  $n_t$  is chosen as 4.

### C. Cross Over

Cross over allows the genes from different parents to be combined in children by exchanging materials between two parents. Cross over function randomly selects a gene at the same coordinate from one of the two parents and assign it to the child. For each chromosome, a random number is selected. If this number is between 0.01 and 0.3 [25], the two parents are combined; else chromosome is transferred with no cross over.

### D. Mutation

GA creates mutation children by randomly changing the genes of individual parents. In this paper, GA adds a random vector from a Gaussian distribution to the parents. For each chromosome, random number is selected. If this number is between 0.01 and 0.1 [25], mutation process is applied; else chromosome is transferred with no mutation.

### E. Fitness Function

The fitness function is defined as in the following:

$$\text{Fitness} = \text{Total Harmonic Distortion} \quad (18)$$

## 6. Simulation Results

Simulations for the system under study were performed in MATLAB Simulink environment. At first, the controller parameters of the PFC were optimized using the proposed GA. Performance evolution of the fitness function (best and average fitness in each iteration) is depicted in Fig. 7. The performance of the PFC controller in the harmonic elimination and current shaping is illustrated in Fig. 8. This figure shows the effectiveness of the proposed PFC scheme in elimination of harmonics and improvement of power quality. Next, the system is exposed to a sudden load change and the response is demonstrated in Fig. 9. These simulations validate the effectiveness of the proposed power factor scheme in harmonic elimination and power factor improvement, simultaneously.



Fig 6: A typical chromosome

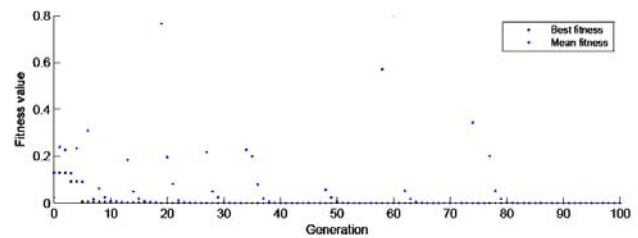


Fig 7: Performance evolution of fitness function (best and average fitnesses in every iteration)

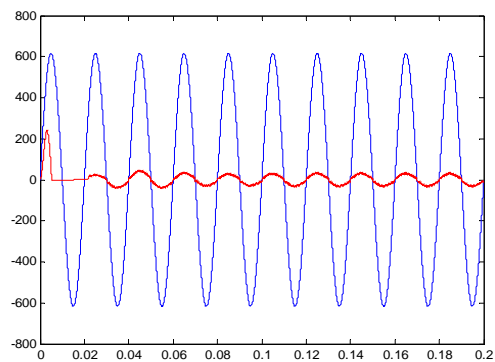


Fig.8: Voltage and current waveforms of micro-turbine after power factor correction

## 7. Conclusion

In this paper, a multi-function nonlinear link for distribution generation systems has been proposed. The main function of this link is to regulate the active power supplied from distribution generation to the utility. The link can also have the ability of supplying reactive power to the utility to operate in the unity power factor or to regulate the voltage at the PCC. This link can also be controlled to mitigate power quality problems. GA has been also used to optimize the performance of power factor correction controller. The effectiveness of the proposed power factor scheme in the harmonic elimination and the power factor improvement has been verified simulations performed in MATLAB/Simulink.

## References

- [1] A. Borbely and J. F. Kreider, Distributed Generation: The Power Paradigm for the New Millennium, Boca Raton, FL: CRC, 2001.
- [2] T. Ackermann, G. Andersson, L. Soder, "Distributed generation: a definition", Electric Power System Research, Vol. 57, 2001.
- [3] R. H. Lasseter, "Control of distributed resources" in: L. H. Fink, C. D. Vournas (Eds.), in Proc. Bulk Power System Dynamics and Control IV, Restructuring, organised by IREP and National Technical Uni. Of Athens, Santorini, Greece, August 23-28, 1998, pp. 323-329.
- [4] F. V. Edwards, G. J. W. Dudgeon, J. R. McDonald and W. E. Leithead, "Dynamics of distribution network with

Distributed Generation”, IEEE/ PES summer meeting 2000, Vol. 2.

[5] P.P. Barker, R.W. De Mello, Power Technol. Inc., “Determining the impact of distributed generation on power systems.I. Radial distribution systems”, IEEE Power Engineering Society Summer Meeting, 2000, Vol 3, pp. 1645-1656 vol. 3

[6] M. Mahmoodi, G.B. Gharehpetian M. Abedi, and R. Noroozian “Control Systems for Independent Operation of Parallel Connected DG Units in Distribution DC Systems“, First International Power and Energy Conference (PECon), 2006, Malaysia. 2006, pp. 220-224

[7] Vu van Thong, Johan Driesen,, Ronnie Belmans, "Overview and omparisons of Existing DG Interconnection Standards and Technical Guidelines", International Conference on Clean Electrical Power, 2007. ICCEP, 2007, Page(s):51 – 54

[8] James M Bing,, Mohammad Y.Vaziri,, "Interconnection of DG to Secondary Network Distribution Systems: An Update", Power Engineering Society General Meeting, 2007. IEEE, 2007 pp. 1 - 2

[9] R. S. Thallam, S. Suryanarayanan,, G.T.Heydt, R. Ayyanar, " Impact of interconnection of distributed generation of electric distribution systems - a dynamic simulation perspective", IEEE Power Engineering Society General Meeting, 2006, pp. 8.

[10] F.Pilo, G.Pisano, G. G.Soma, "Neural Implementation of MicroGrid Central Controllers", IEEE 5th International Conference on Industrial Informatics, 2007, Vol 2, pp. 1177 – 1182.

[11] M. I. Marei, E. F. El-Saadany, M. M .A. Salama, " A novel control algorithm for the DG interface to mitigate power quality problems", IEEE Transactions on Power Delivery, 2004, Vol 19pp. 1384 – 1392.

[12] C.J. Gajanayake, D.M. Vilathgamuwa, P.C .Loh, F. Blaabjerg, R.Teodorescu, "Z -source Inverter Based Flexible DG System with P+resonance and Repetitive Controllers for Power Quality Improvement of a Weak Grid", IEEE Power Electronics Specialists Conference, 2007. PESC 2007, 17-21 June 2007 Page(s):2457 – 2463

[13] He. Wenqiang; H.P. Nee, "Current Harmonics Analysis of The DG Interconnection by Modeling and Simulation", IEEE/PES Transmission and Distribution Conference and Exhibition: Asia and Pacific, 2005 pp. 1 - 4

[14] A. Al-Hinai, K. Schoder, and A. Feliachi, “Control Of Grid-Connected Split Shaft Microturbine Distributed Generator,” System Theory, Proc. 35th Southeastern Symposium, pp. 84 –88, 2003.

[15] H. Nikkhajoei and M.R. Iravani, “Modeling and Analysis of a Microturbine Generation System” IEEE Power Engineering Society Summer Meeting, 2002, Vol .1, pp. 167 -169,.

[16] A.M. Zarringhalam; M. Kazerani, "Comprehensive analysis of a dispersed generation scheme based on microturbine and induction generator", IEEE Power Engineering Society General Meeting, 2004., Vol 2, pp. 2206 – 2211.

[17] H. Nikkhajoei, M. Saedifard, R. Iravani, "A Three-Level Converter based Micro-Turbine Distributed Generation System", IEEE Power Engineering Society General Meeting, 2006, pp. 1- 6

[18] H. Nikkhajoei and M. R. Iravani, “A matrix converter based micro-turbine distributed generation system,” IEEE Trans. on Power Delivery, 2005, Vol. 20 No. 3, pp. 2182-2192.

[19] D.N. Gaonkar, R.N. Patel, “Modeling and Simulation of Microturbine Based Distributed Generation System”, IEEE Power India Conference, 2006, pp. 1-5.

[20] A. Al-Hinai, A. Feliachi, “Dynamic Model Of A Microturbine Used As A Distributed Generator,” Proc. 34th Southeastern Symposium on system Theory,2002, Alabama pp.209-213

[21] Chee-Mun Ong, Dynamic Simulation of Electric Machinery Using Matlab / Simulink, Prentice Hall 1997.

[22] N.Mohan, W.P.Robbins, T.M.Undeland "Power Electronics Converter, Application and Design", 3<sup>rd</sup> Edition, Wiley-IEEE Press; 2002.

[23] Wanfeng Zhang; Guang Feng; Yan-fei Liu; Bin Wu, “A direct duty cycle calculation algorithm for digital power factor correction (PFC) implementation”, Power Electronics Specialists Conference, 2004. PESC 04. 2004 IEEE 35th Annual Volume 3, 20-25 June 2004 Page(s):2326 - 2332 Vol.3

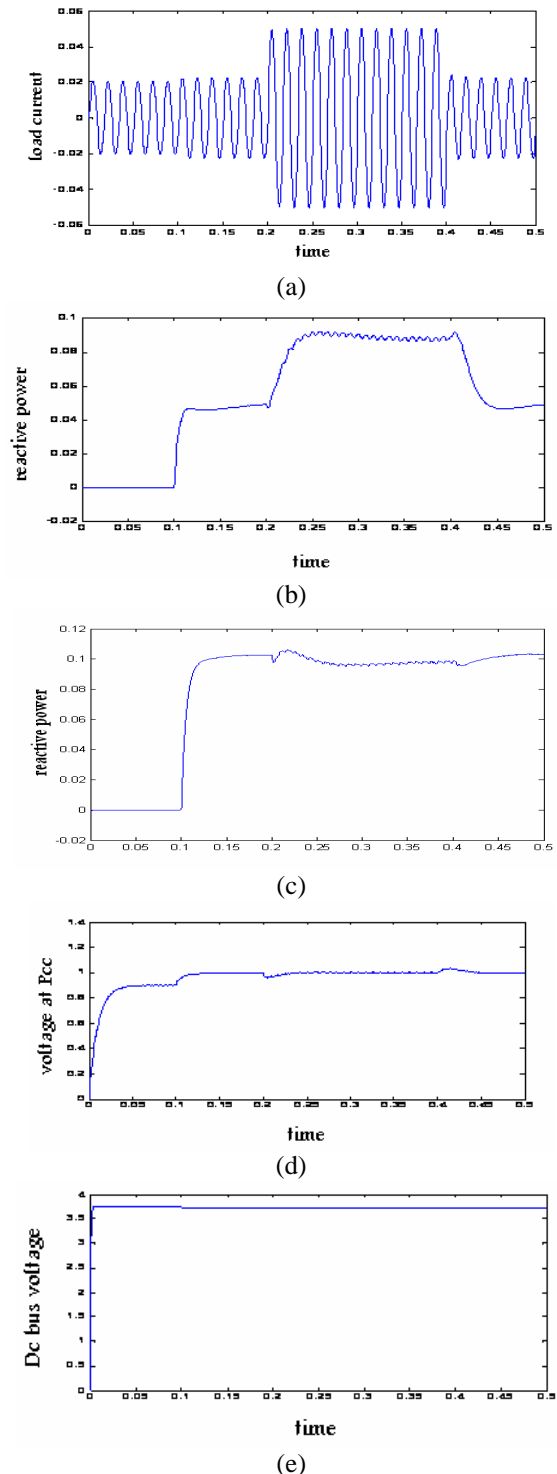


Fig. 9: Reactive power compensation corresponding to sudden load change. (a) Load Current (kA), (b) Compensated Mega Var, (c) Mega Watt supplied by the proposed configuration, (d) Voltage at PCC (per unit) and (e) DC-bus voltage (kV)